

Cooling Bath 126 kg

Model – Cooling bath 126 kg with pull-out baskets



metos
cooking solutions

Metos Cooking Solutions

Ahjonkaarre, FI-04220 Kerava, Finland

Tel. +358 204 3913

mcs@metos.com

mcs.metos.com



Standard features

- Designed in polished, stainless steel, material AISI 304
- The baskets are lifted by crane, mounted above the Cooling bath
- Features a built-in CIP system for automatic cleaning of concealed pipes and exchangers
- Colour touch-screen
- All recipes are made on the touch-screen
- Temperature / data log with USB storage device for self-monitoring
- Programs can be stored
- Remembers and restarts automatically on power failure
- Capacity to cool down 126 kg product from +95°C to +3°C
- Nozzles to achieve the best possible circulation
- Mounted outflow strainer at the bottom of the bath
- Exchanger to prevent the cooling water/ product water to mix with ice water/process water
- The cool down period depends on product type and the layer thickness
- The cold water temperature must be no more than 15°C. If the temperature of the supplied water is higher, it should be mentioned when ordering due to the capacity of the cooler.
- The cold water must be changed as needed.

14 pcs pull-out baskets - size L730 mm x W330 mm x H80 mm
1 pcs cage for 14 baskets
1 pcs basket trolley

Bath

Kg per batch	126 kg
Water capacity	576 L
Water Consumption	450 L
Dimensions L x W x H	1544 x 1333 x 1095 mm
Power supply	3x400V + Earth, 50 Hz
Input power	3 kW
Input current, amp	10 A
Drain diameter	100 mm
Cold water	3/4" 3 bar
Glycol/cooling water connection	38mm 1,5"
Pumps	1 pcs
Weight with baskets without water	350 kg
Weight with water, baskets, product	926 kg

Crane

Dimensions, rail length x height	3094 x 2528 mm
CEE plug, supply	230V, 50 Hz
Motor effect	300 W

Remote Chilling Unit ANL-Q 070 Air cooled

- 1 pcs compact chiller with build-in water tank, flow pump and electric control
- Electronic fan control (winter management)
- Freon and environmental control charge is included

Placing of the ANL Chiller air-cooled unit:

The chiller must be placed outside or at a ventilated location due to high heat emission.




The surface under the unit must be flat, smooth and sufficiently strong to withstand the weight of the unit with a full refrigerant load, as well as the normal maintenance equipment. Place the cooler outside in a place that is not exposed to excessive wind (install windbreaks if the wind speed exceeds 2.2 m/s).

Chilling Unit ANL-Q 070

Cooling capacity	16,7 kWh at -1°C in flow / + 4°C at return (water-glycol mixture 70/30)
Freon type	R-410 A
Flow pump	1 pcs
Flow rate	2834 l/h by 159 kPa
Power supply	3 x 400 Volt + Neutral + Earth, 50 Hz
Input power	5 kW
Input current, amp	11 A
Dimensions L x W x H	1165 x 550 x 1281 mm
Weight including glycol	226 kg

Cooling Bath 126 kg

metos

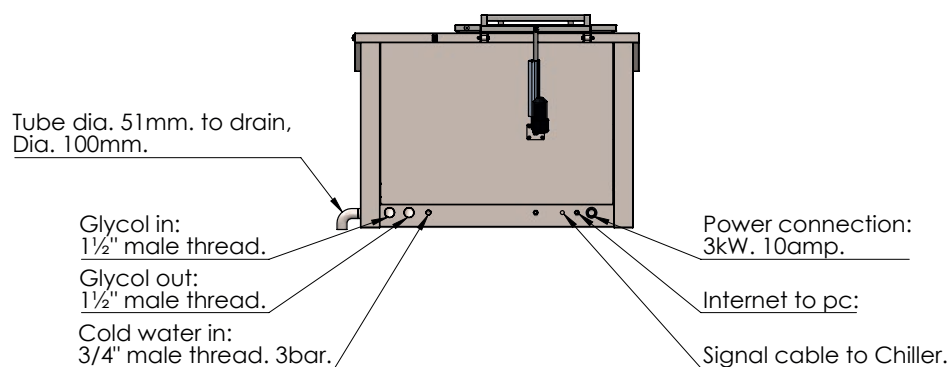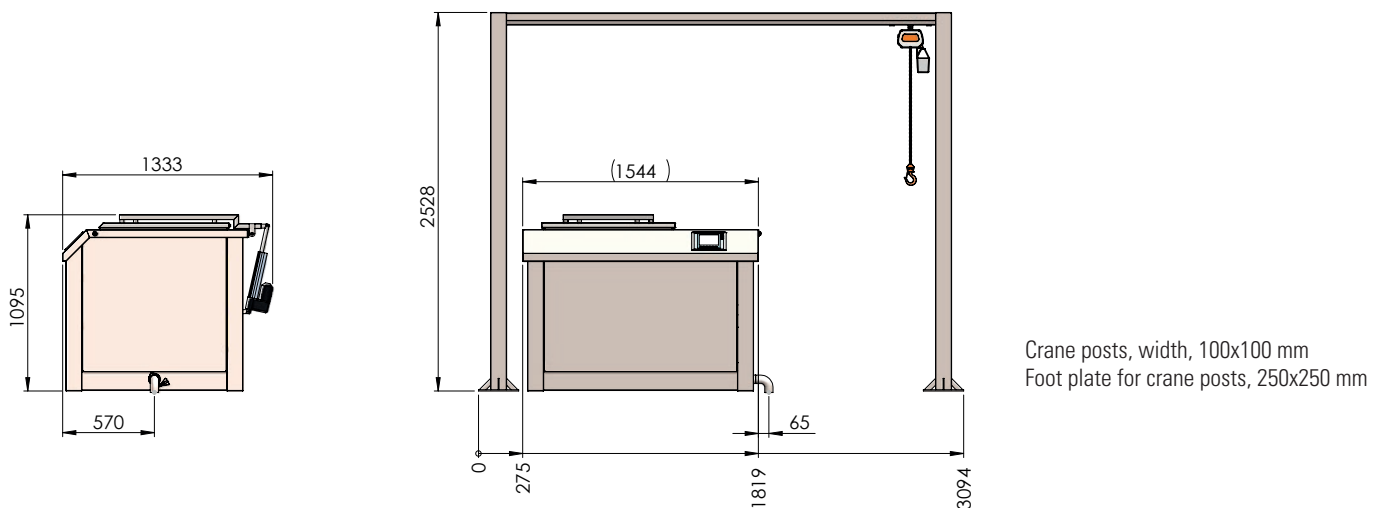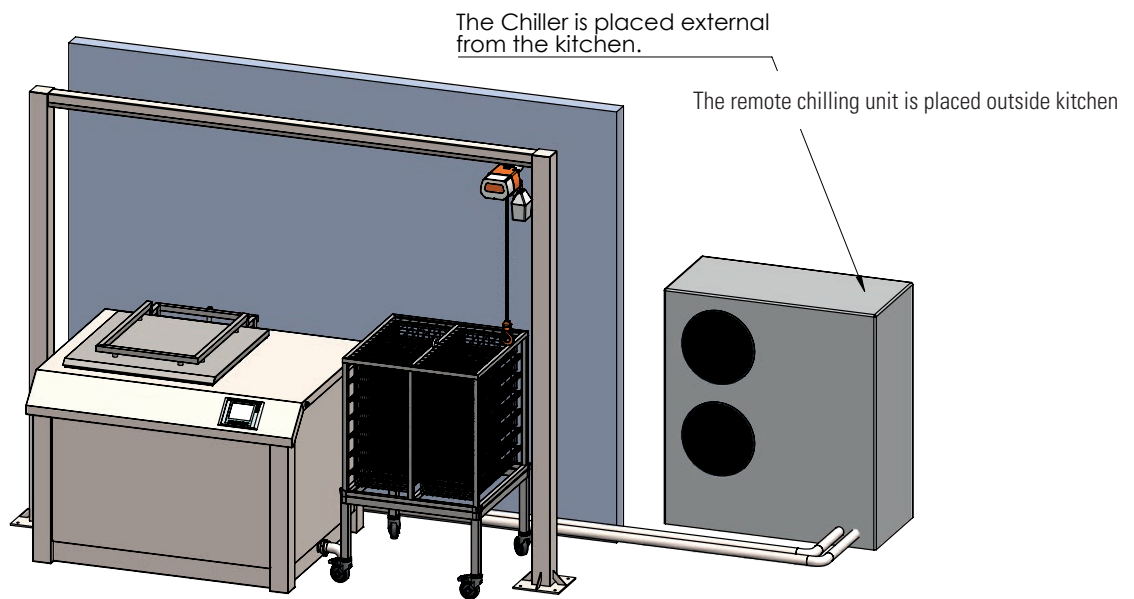

Glycol / cooling water connection between bath and chiller must be 38 mm stainless steel pipe 1,5" male thread, length max 20 metres.